


SECTION WITH COVER SLAB

NTS

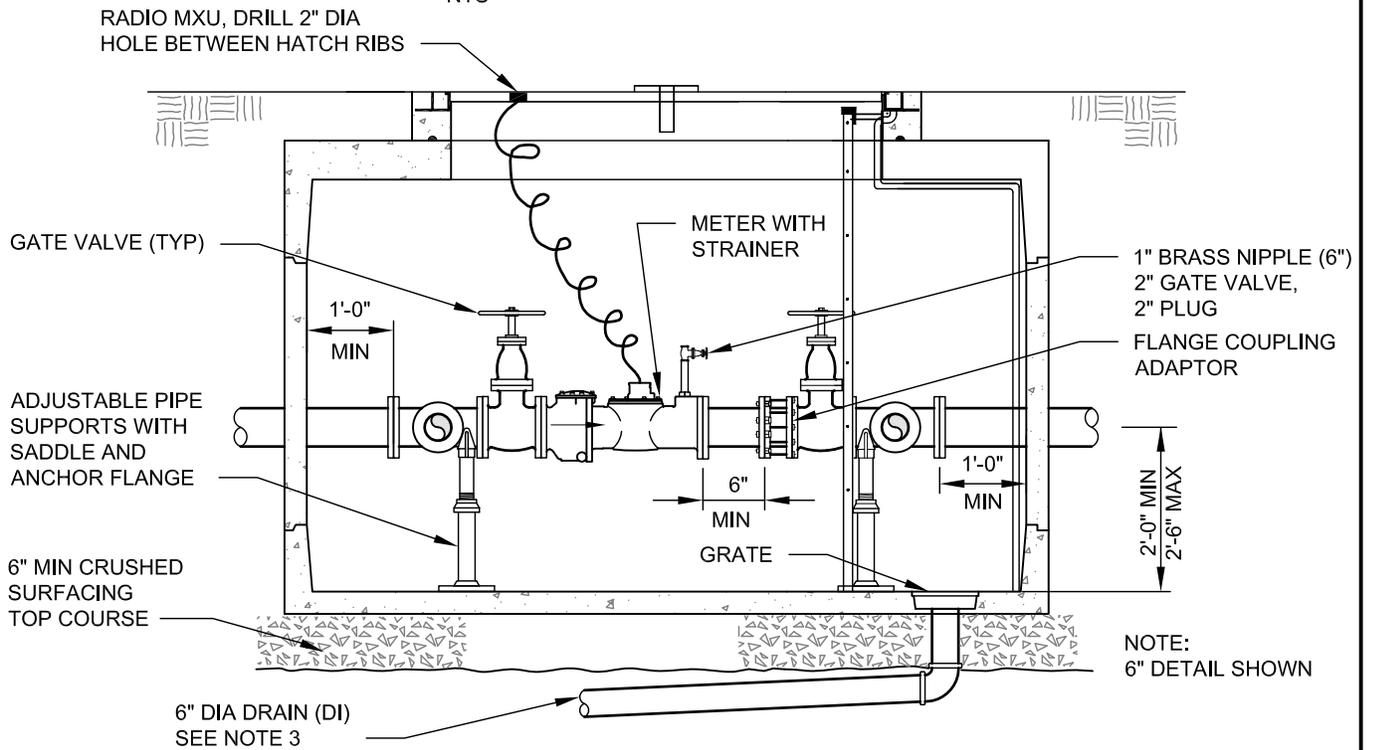


SECTION OF EQUIPMENT

NTS

NOTES:

1. SET COVER SLAB FLUSH WITH SIDEWALK OR CURB ELEVATION IF LOCATED IN LAWN AREA. SET COVER SLAB APPROXIMATELY 2 INCHES ABOVE FINISHED GRADE IF LOCATED IN LANDSCAPING AREA.
2. HATCH FRAME DRAIN CAST IN CONCRETE SHALL BE 1 -1/2 INCH BRASS. REMAINDER OF HATCH FRAME DRAIN SHALL BE 1 - 1/2 INCH SCH 40 PVC IN VAULT. USE 45° BENDS WHERE POSSIBLE AND PROVIDE UNIONS TO ALLOW DISASSEMBLY OF PIPING. ATTACH TO VAULT WITH STAINLESS STEEL HARDWARE.
3. A GRAVITY VAULT DRAIN (DI) SHALL BE CONNECTED TO STORM SYSTEM AS SHOWN ON THE DRAWINGS.

Scott Thomasson
 APPROVED BY: SCOTT THOMASSON
 WATER/WASTEWATER ENGINEERING MANAGER
 REVISION DATE: JULY 01, 2015



STANDARD DETAILS
WATER METER SECTIONS
3", 4", 6" METER DETAILS
 FILE NAME: SD705A.DWG DETAIL NUMBER: **705A**