


PLAN
NTS

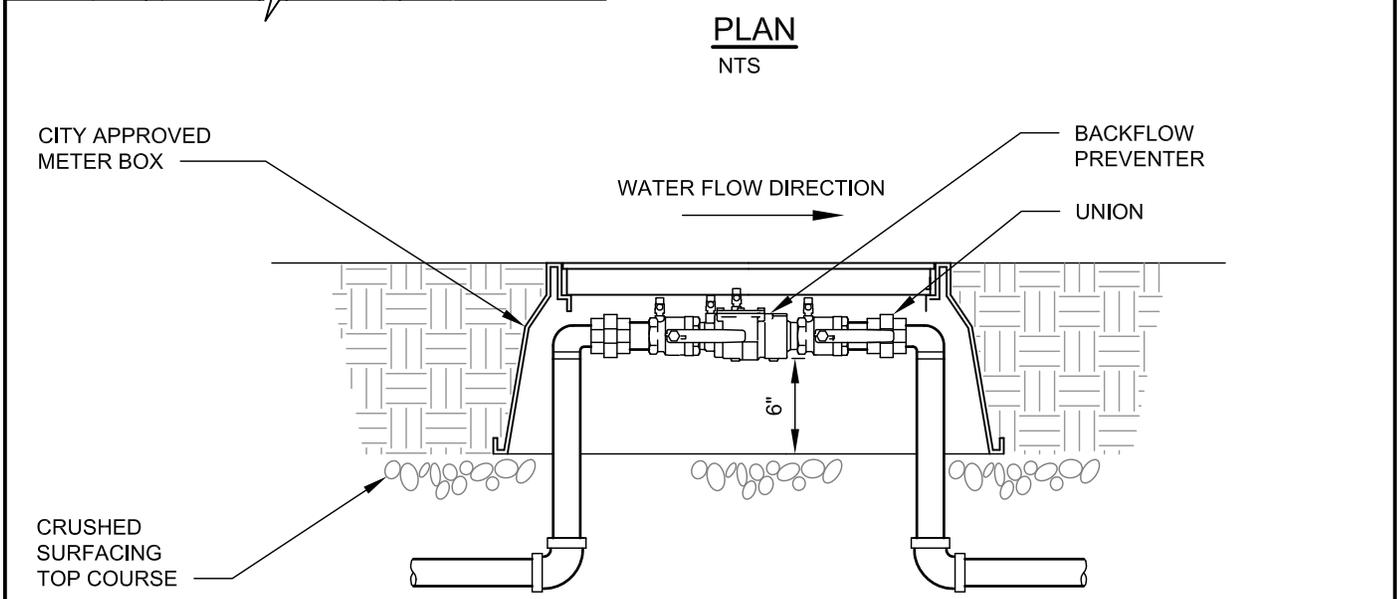


ELEVATION
NTS

NOTES:

1. DOUBLE CHECK VALVE ASSEMBLY SHALL MEET REQUIREMENTS OF THE LATEST EDITION AWWA "ACCEPTED PROCEDURE AND PRACTICE IN CROSS-CONNECTION CONTROL" MANUAL.
2. DEVICES MUST BE ON THE LATEST EDITION OF THE WASHINGTON STATE HEALTH DEPARTMENT LIST OF APPROVED CROSS-CONNECTION CONTROL DEVICES.
3. METER BOX SIZE SHOULD BE THE SIZE SPECIFIED FOR THE METER SIZE EQUIVALENT TO THE BACKFLOW PREVENTOR SIZE.
4. IRRIGATION BLOW OUT CONNECTION FOR WINTERIZATION SHALL BE LOCATED DOWNSTREAM OF THE DOUBLE CHECK VALVE ASSEMBLY IN A SEPARATE IRRIGATION VALVE BOX.

Scott Thomasson
 APPROVED BY: SCOTT THOMASSON
 WATER/WASTEWATER ENGINEERING MANAGER
 REVISION DATE: JULY 01, 2015



STANDARD DETAILS
IRRIGATION BACKFLOW PREVENTER (3/4" - 2")
 FILE NAME: SD711.DWG DETAIL NUMBER: **711**