


GUARD POST DETAIL

NTS

UNOBSTRUCTED ACCESS ROADWAY

NTS

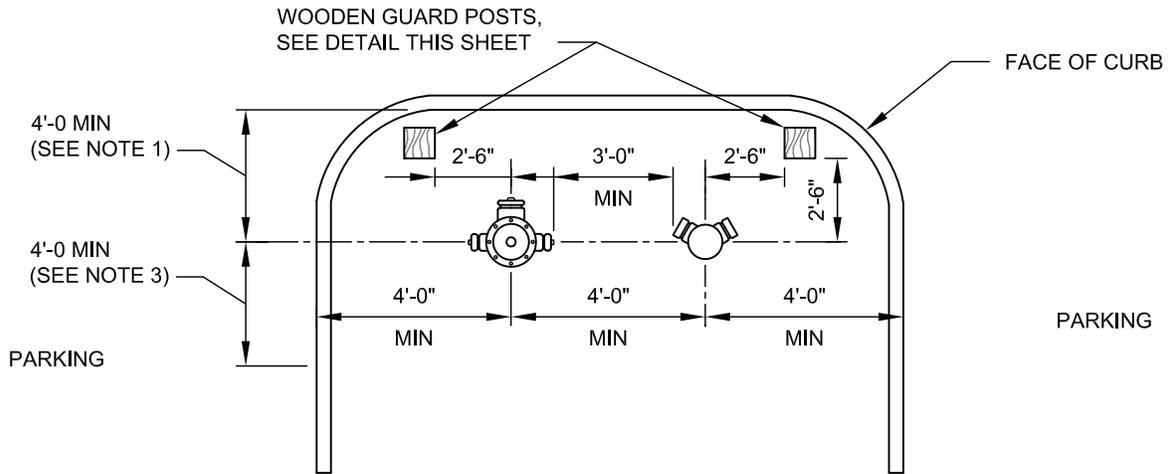


UNOBSTRUCTED ACCESS ROADWAY

NTS

NOTES:

1. GUARD POSTS ARE REQUIRED IF HYDRANT AND/OR FIRE DEPARTMENT CONNECTION ARE LESS THAN 4 FEET FROM CURB LINE, OR WHEN OTHERWISE DETERMINED NECESSARY BY THE FIRE MARSHAL OR WATER DEPARTMENT.
2. ONLY GROUND COVER LANDSCAPING SHALL BE PLANTED WITHIN DIMENSIONED AREAS.
3. A 4 FOOT MINIMUM AREA SHALL BE FREE FROM PLANTS OR SHRUBS OR OTHER OBSTRUCTIONS.
4. A 8 FOOT MINIMUM AREA SHALL BE FREE FROM TREES.
5. INSTALL 3/4 INCH VIKING AUTOMATIC BALL DRIP VALVE IN ACCORDANCE WITH NFPA STANDARDS. PLACE SADDLE ON HORIZONTAL PIPING (FDC LINE) 2 FEET FROM FITTING TO FDC.

Scott Thomasson
 APPROVED BY: SCOTT THOMASSON
 WATER/WASTEWATER ENGINEERING MANAGER
 REVISION DATE: JULY 01, 2015



STANDARD DETAILS
FIRE HYDRANT AND STANDPIPE LOCATION
 FILE NAME: SD712.DWG DETAIL NUMBER: **712**