


PLAN
NTS

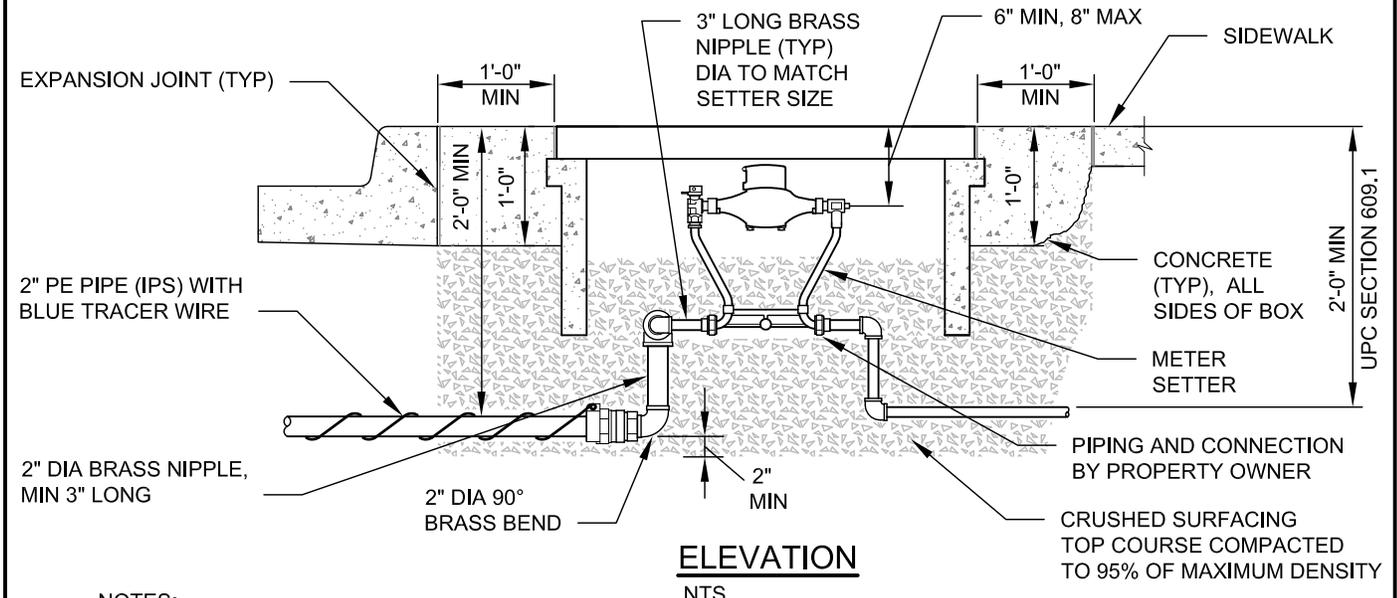

ELEVATION
NTS

NOTES:

1. THIS INSTALLATION SHALL ONLY BE USED IN URBAN STREETSCAPES WHERE LANDSCAPE AREAS ARE NOT AVAILABLE AND WHERE APPROVED BY THE CITY.
2. SEE STANDARD DETAIL 701A FOR ADDITIONAL DETAILS.
3. SET METER BOX FLUSH WITH SIDEWALK.
4. SERVICE CONNECTION PIPE SIZE SHALL BE 2 INCH DIAMETER.
5. ALL FITTINGS SHALL BE BRASS.
6. METER(S) SHALL BE CENTERED IN THE BOX TO MAINTAIN EVEN CLEARANCE FROM EDGES OF BOX.
7. TOUCH READ PAD HOLE TO BE DRILLED BY THE CITY.

 APPROVED BY: SCOTT THOMASSON WATER/WASTEWATER ENGINEERING MANAGER	 City of Redmond WASHINGTON	STANDARD DETAILS 5/8" X 3/4" AND 1" DOUBLE METERS IN SIDEWALK FILE NAME: SD721.DWG DETAIL NUMBER: 721
REVISION DATE: JULY 01, 2015		