



CAPS / PLUGS

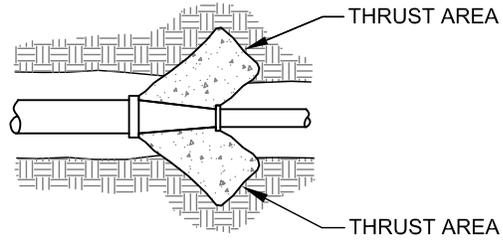


REDUCERS

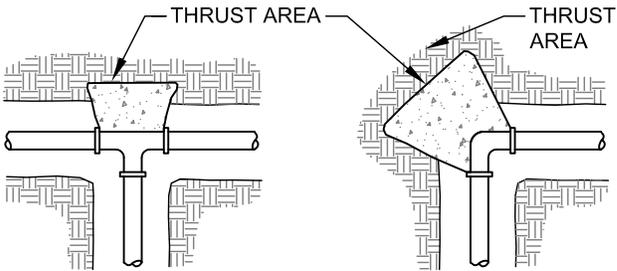

TEES

ELLS

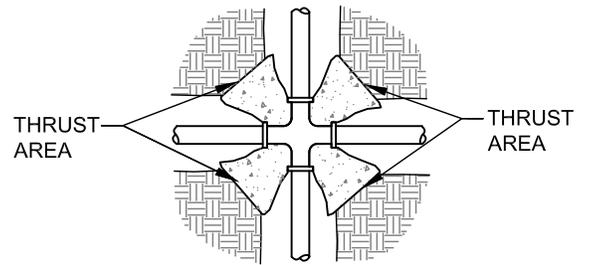

CROSSES

| FITTING SIZES | BEARING AREA OF BLOCK IN SQUARE FEET | | | |
|------------------|--------------------------------------|----------|----------|------------|
| | TEES & ENDS | 90° BEND | 45° BEND | 22.5° BEND |
| 4" | 1-1/2 | 2 | 1-1/2 | 1-1/2 |

ALL BLOCKING SHALL BE POURED AGAINST FIRM UNDISTURBED SOIL.
SOIL BEARING PRESSURE SHALL EXCEED 4,500 LB PER SQUARE FOOT
FOR ABOVE AREAS.

SECTION

NTS

Dave Tuckek

APPROVED BY: DAVE TUCHEK
PARKS MAINTENANCE AND OPERATIONS MANAGER

REVISION DATE: JULY 01, 2014



City of Redmond
WASHINGTON

STANDARD DETAILS

THRUST BLOCK

FILE NAME: SD718.DWG

DETAIL NUMBER: **923**