


**PLAN**  
NTS

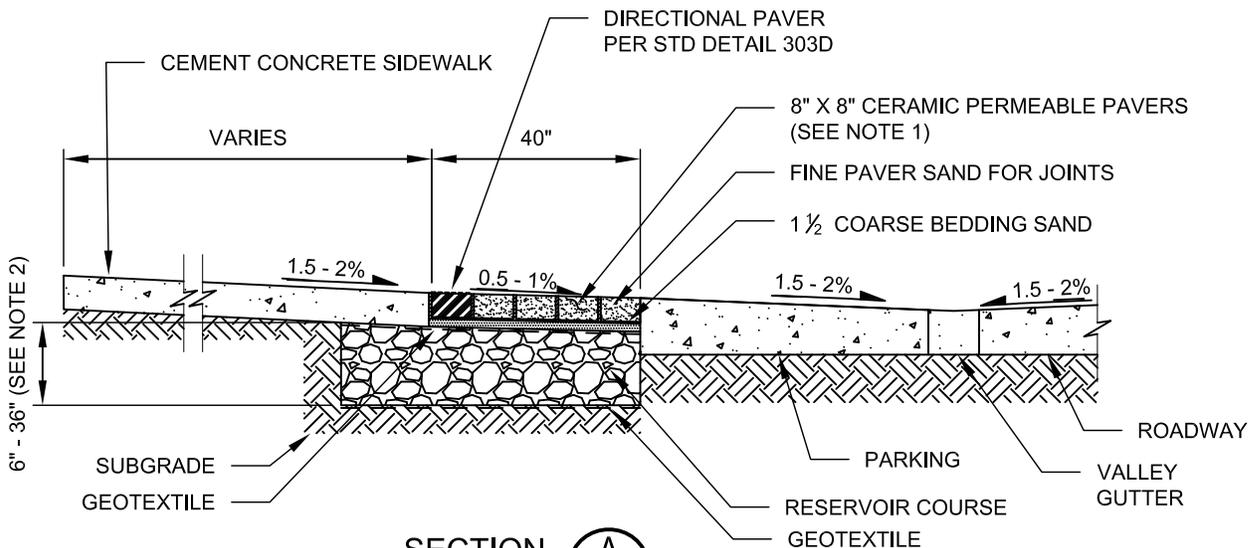

**SECTION A**  
NTS

**NOTES:**

1. CERAMIC PERMEABLE PAVERS SHALL MEET THE FOLLOWING SPECIFICATIONS:
  - A. DIMENSIONS: 8" X 8" X 2 3/8"
  - B. COLOR: CHARCOAL (SUBJECT TO CITY APPROVAL)
  - C. COMPRESSIVE STRENGTH: 6,000 PSI
  - D. INFILTRATION RATE THROUGH PAVER: 2 INCHES/HOUR MINIMUM
2. SEE STANDARD DETAIL 643 FOR RESERVOIR COURSE AND GEOTEXTILE SPECIFICATION. DIMENSIONS OF RESERVOIR COURSE REQUIRES SITE-SPECIFIC DESIGN, SUBJECT TO APPROVAL OF THE STORMWATER ENGINEER.
3. PLACEMENT OF BEDDING SAND, INSTALLATION OF PAVERS, AND APPLICATION OF JOINT SAND SHALL BE IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION SPECIFICATIONS.
4. ADJACENT CURB AND SIDEWALK SHALL BE CONSTRUCTED PRIOR TO PAVER INSTALLATION. NO JOINT MATERIAL, ONLY JOINT SAND, SHALL BE USED BETWEEN PAVER AND ADJACENT CONCRETE.

*Paulette Norman*

APPROVED BY: PAULETTE NORMAN  
DEVELOPMENT ENGINEERING MANAGER

REVISION DATE: JULY 01, 2015



City of Redmond  
WASHINGTON

STANDARD DETAILS

**DOWNTOWN PEDESTRIAN  
SIDEWALK WITH CERAMIC  
PERMEABLE PAVER BAND**

FILE NAME: SD303C.DWG

DETAIL NUMBER: **303C**