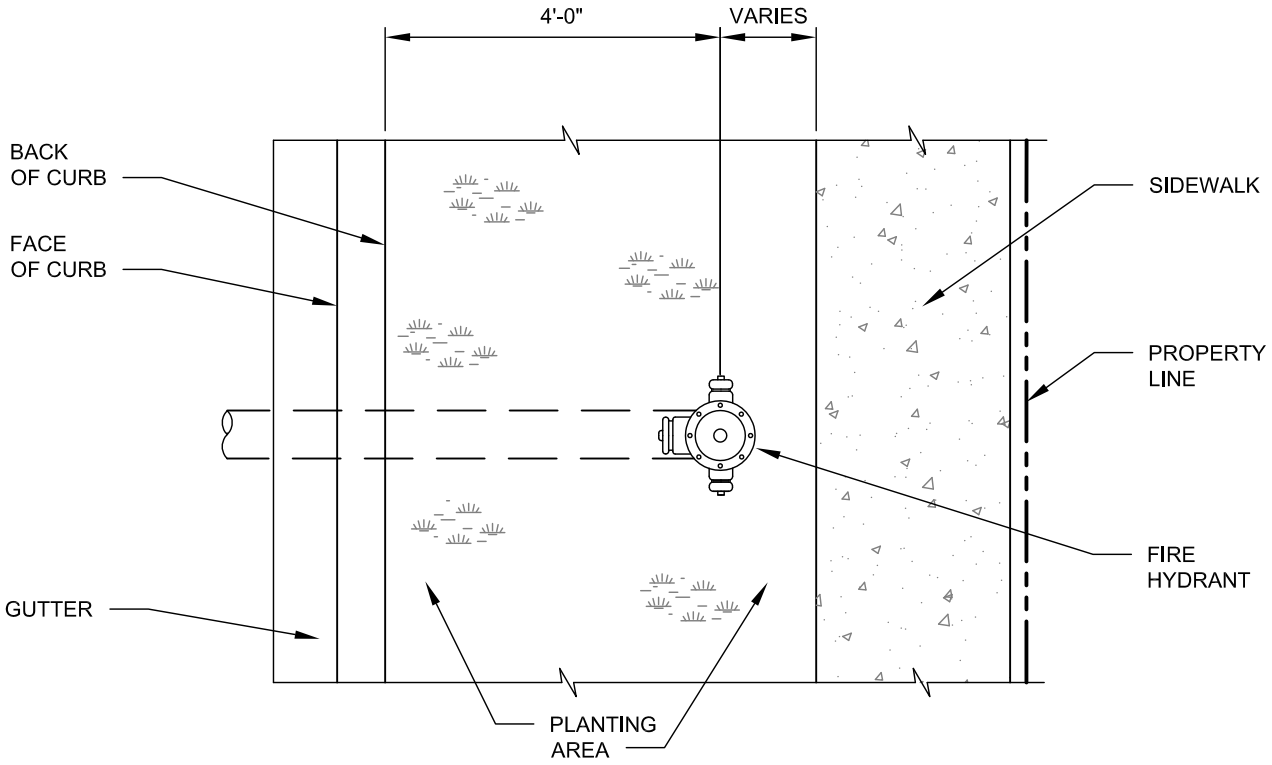

FIRE HYDRANT

NTS

APPROVED BY: SCOTT THOMASSON
WATER/WASTEWATER ENGINEERING MANAGER

REVISION DATE: JULY 01, 2014

CityofRedmond
WASHINGTON

STANDARD DETAILS

HYDRANT LOCATION WITHIN PLANTING AREA

FILE NAME: SD716.DWG

DETAIL NUMBER: **716**